



**PLAN VIEW**

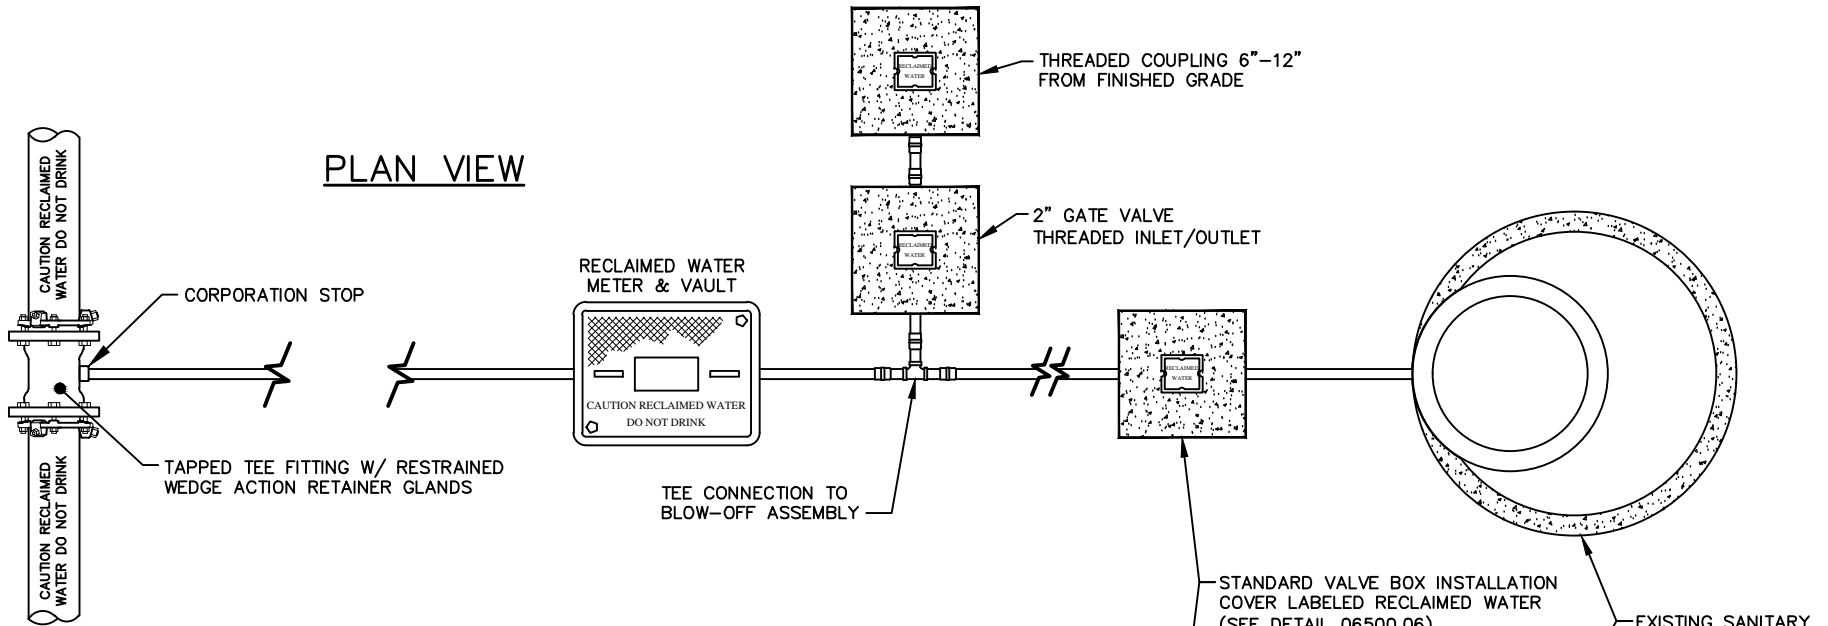

**SECTION VIEW**

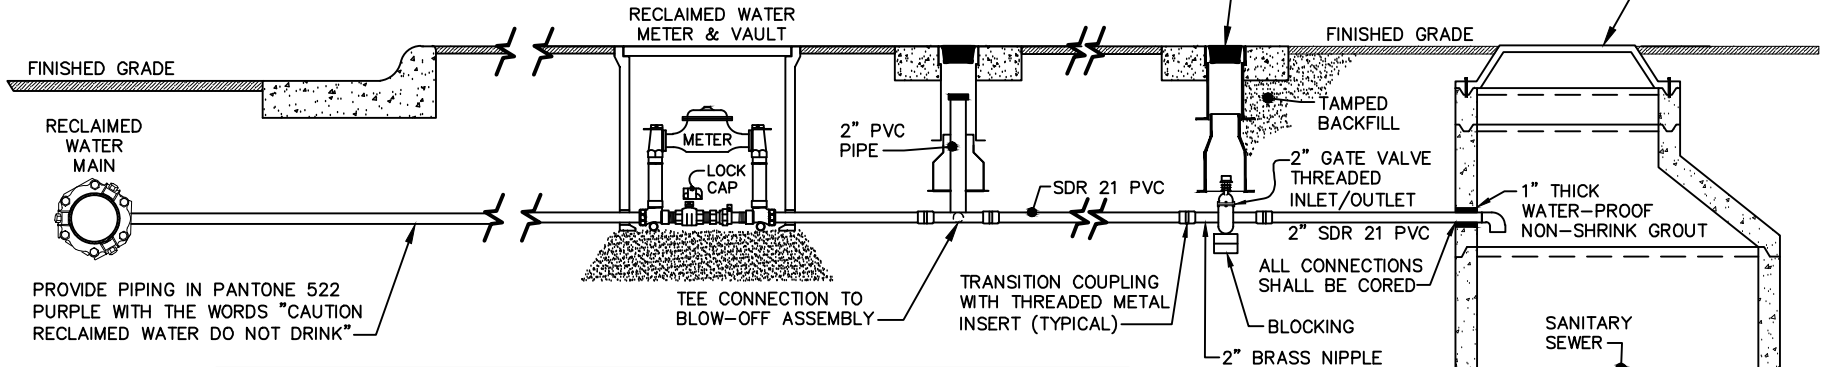

- NOTES:**
- 1) FOR MAINS THAT ARE TO BE EXTENDED, USE A VALVE EQUAL TO THE MAIN SIZE AS THE BLOW-OFF VALVE AND THEN REDUCE TO THE 2" SDR 21 PVC PIPE.
  - 2) SDR 21 PVC PIPE SHALL BE PROVIDED WITH 200 P.S.I. PRESSURE RATING AND CONNECTED WITH BELL/SPIGOT SOLVENT WELD JOINTS.
  - 3) SDR 21 PIPE SHALL BE PROVIDED IN PANTONE 522 PURPLE AND LABELED "CAUTION RECLAIMED WATER DO NOT DRINK".

**STANDARD RECLAIMED WATER BLOW-OFF ASSEMBLY, TYPE 3  
(EXISTING SANITARY SEWER MANHOLE)**

DETAIL No.

06500.04  
SHEET 4 OF 4



EFFECTIVE: 12/10/09