


**FORCED AIR CARBON  
ABSORPTION SCRUBBER**



**NOTES:**

- 1) FORCED AIR ODOR CONTROL SYSTEM RATED FOR AIR FLOWS NOT EXCEEDING 500 cfm.
- 2) ODOR CONTROL CANISTER SHALL BE SECURED TO CONCRETE PAD.

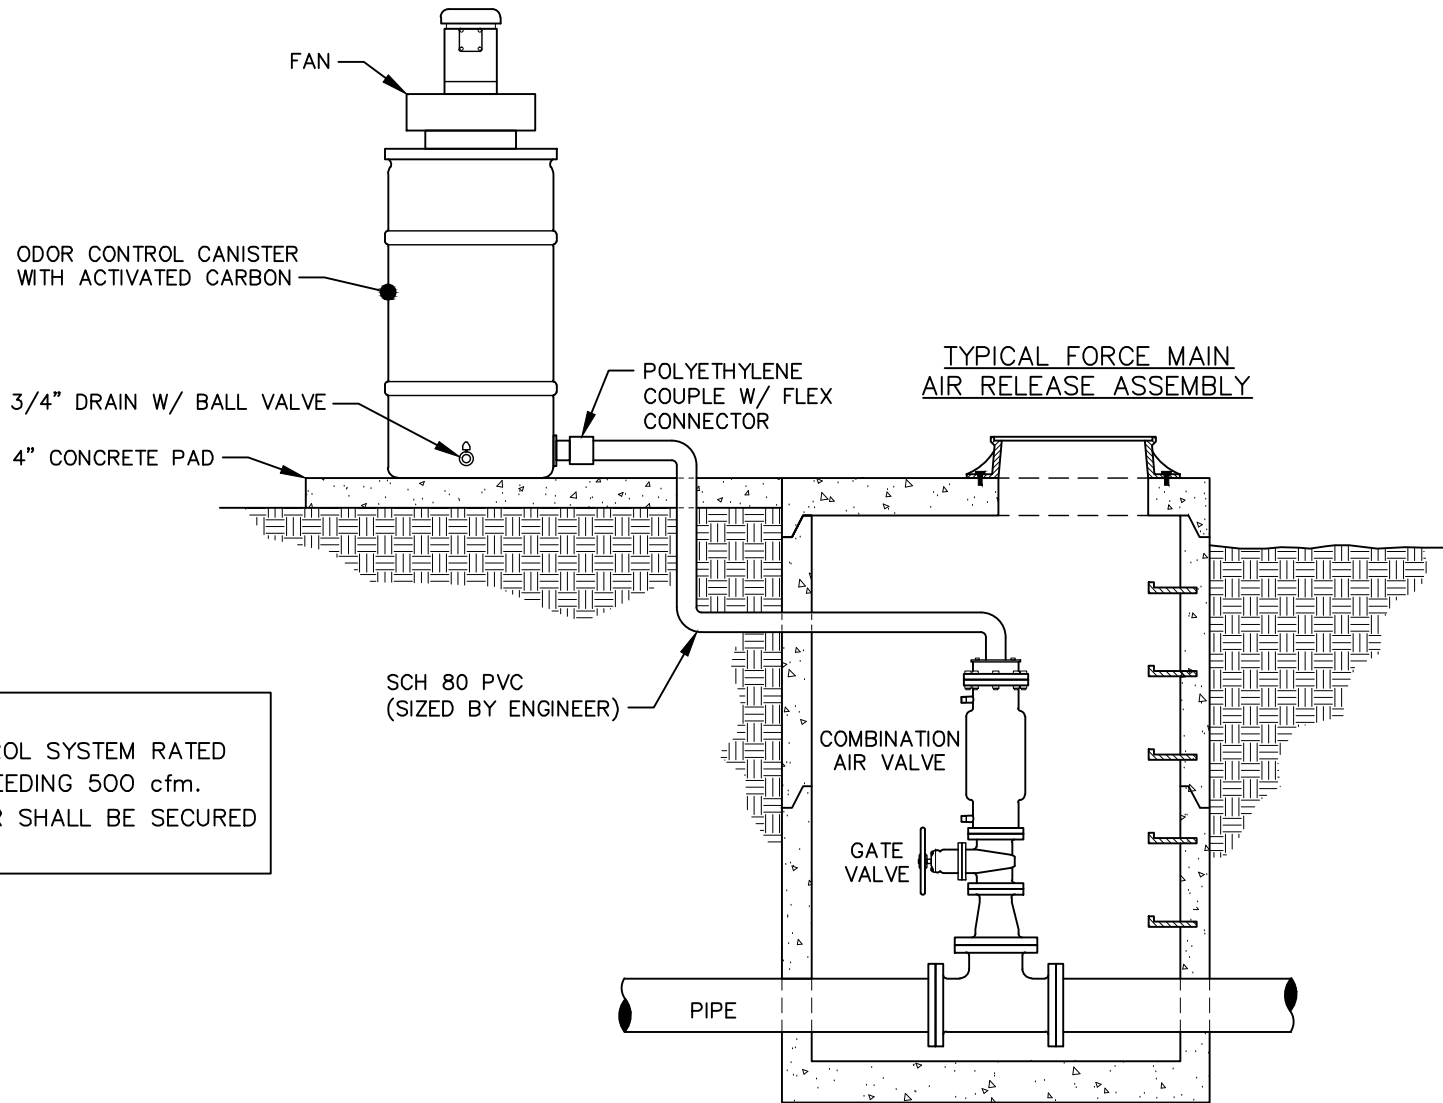

EFFECTIVE: 12/10/09

**TYPICAL FORCE MAIN FORCED AIR ODOR CONTROL SYSTEM**

DETAIL No.

07200.04  
SHEET 2 OF 2