


NOTES:

1. PUMP STATION PROPERTY OR EASEMENT SHALL BE 50' x 50' (ft.) MINIMUM.
2. EQUIPMENT LOCATIONS AND DIMENSIONS MAY VARY.
3. SITE WITHIN FENCE SHALL BE 5" (inches) THICK REINFORCED CONCRETE SLAB OR 3" (inches) CRUSHED STONE OVER GEOTEXTILE FABRIC (SPECIFIED BY TOWN ENGINEER).
4. THE PUMP STATION SITE LAYOUT AND DESIGN SHALL MEET ALL TOWN OF CARY SITE PLANNING AND DESIGN REQUIREMENTS.



PUMP STATION SITE LAYOUT

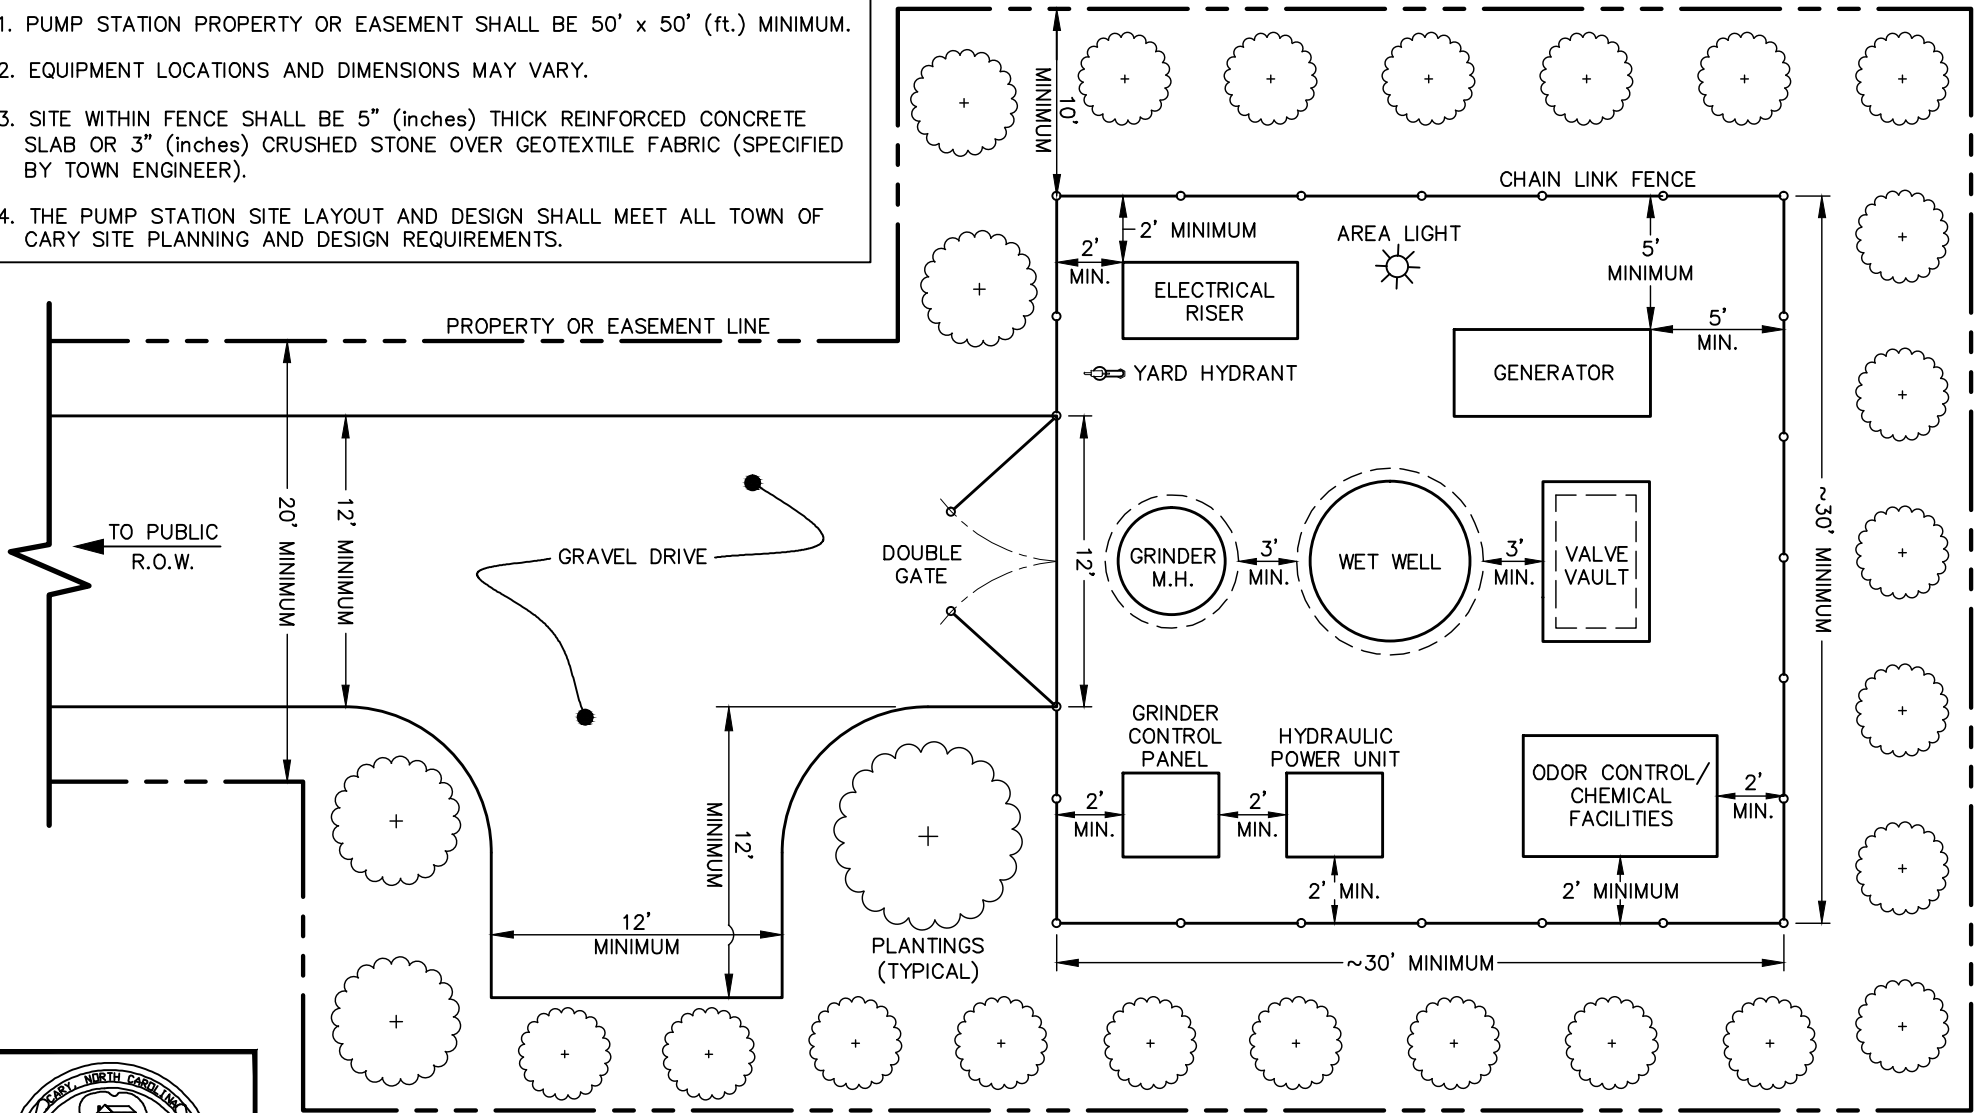

EFFECTIVE: 12/10/09

DETAIL No.

07500.01
SHEET 1 OF 1