



ELEVATION VIEW

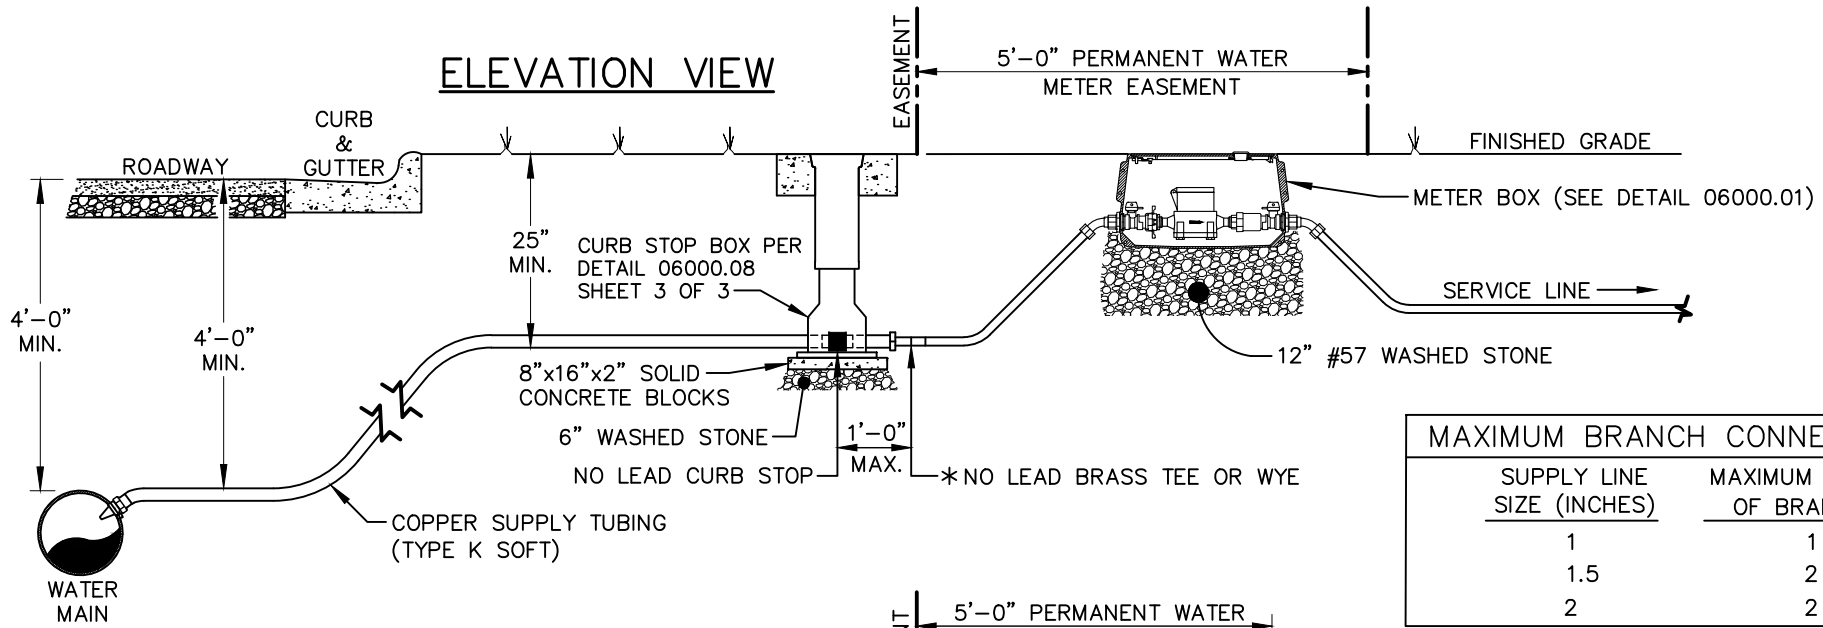

MAXIMUM BRANCH CONNECTIONS	
SUPPLY LINE SIZE (INCHES)	MAXIMUM NUMBER OF BRANCHES
1	1
1.5	2
2	2

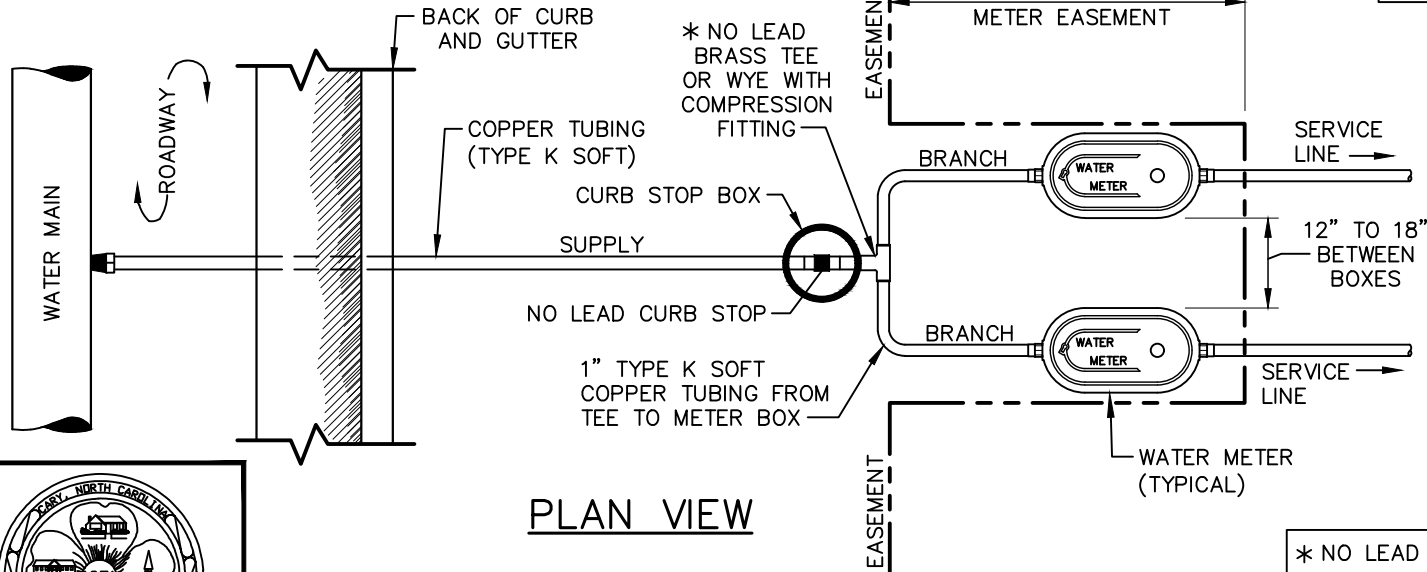

- NOTES:**
1. THERE SHALL BE NO MULTIPLE CONNECTIONS FROM EXISTING 3/4 INCH SERVICE LINES.
 2. METER BOXES SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC.
 3. NO LEAD CURB STOP SHALL BE CENTERED ON MULTIPLE BRANCH SERVICE.
 4. ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.
 5. MARKING TAPE SHALL BE INSTALLED FOR ALL SERVICE CONNECTIONS FROM THE MAIN LINE TO THE METER FOR ALL NEW CONSTRUCTION OR RETROFIT INSTALLATIONS USING OPEN TRENCH METHODS.

* NO LEAD BRASS TEE OR WYE: INLET SIZE X 1 INCH

PLAN VIEW

STANDARD MULTIPLE BRANCH SERVICES

DETAIL No.

06000.04
SHEET 1 OF 1

EFFECTIVE: 01/05/17