


**NOTES:**

1. SEE SHEET 1 OR 2 FOR GENERAL TOP VIEW.
2. UL/FM AIR COMPRESSOR MAY ALSO BE FLOOR MOUNTED.

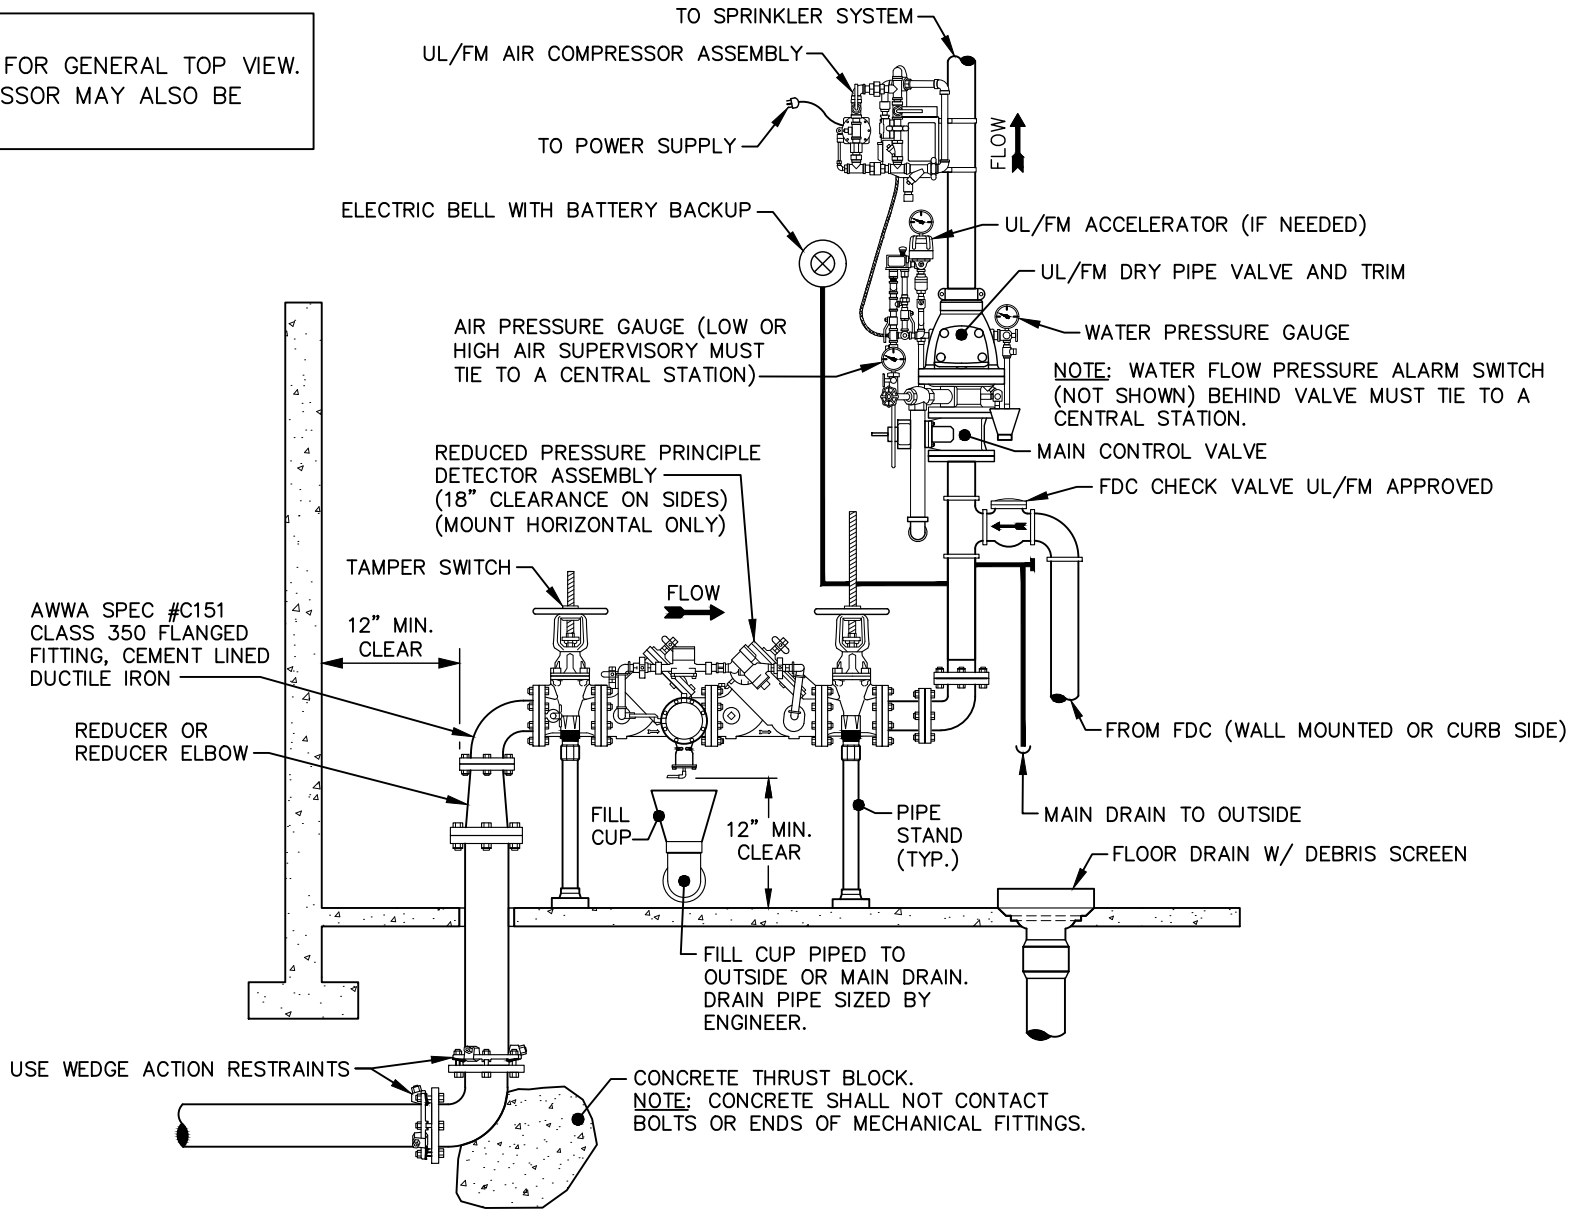

EFFECTIVE: 01/05/17

**DRY PIPE SPRINKLER RISER, NFPA 13**

DETAIL No.

06000.17

SHEET 3 OF 3