



- NOTES:**
1. PIPING CONFIGURATION TO BE USED ON ALL DROPS OVER 20 INCHES.
  2. DROPS TO BE CONSTRUCTED OF DUCTILE IRON OR SCH 80 PVC PIPE.
  3. SERVICE LINE MAY NOT ENTER MANHOLE THROUGH CONE SECTION OR ANY JOINT.
  4. THIS DETAIL SHALL NOT BE USED FOR FORCE MAINS
  5. ALL MANHOLE CONNECTIONS SHALL BE CORED.
  6. USE 1/2 INCH DIAMETER EXPANSION TYPE STAINLESS STEEL CINCH BOLTS WITH STAINLESS STEEL WASHERS AND NUTS TO ATTACH STRAPS.
  7. MINIMUM OF TWO STRAPS REQUIRED.

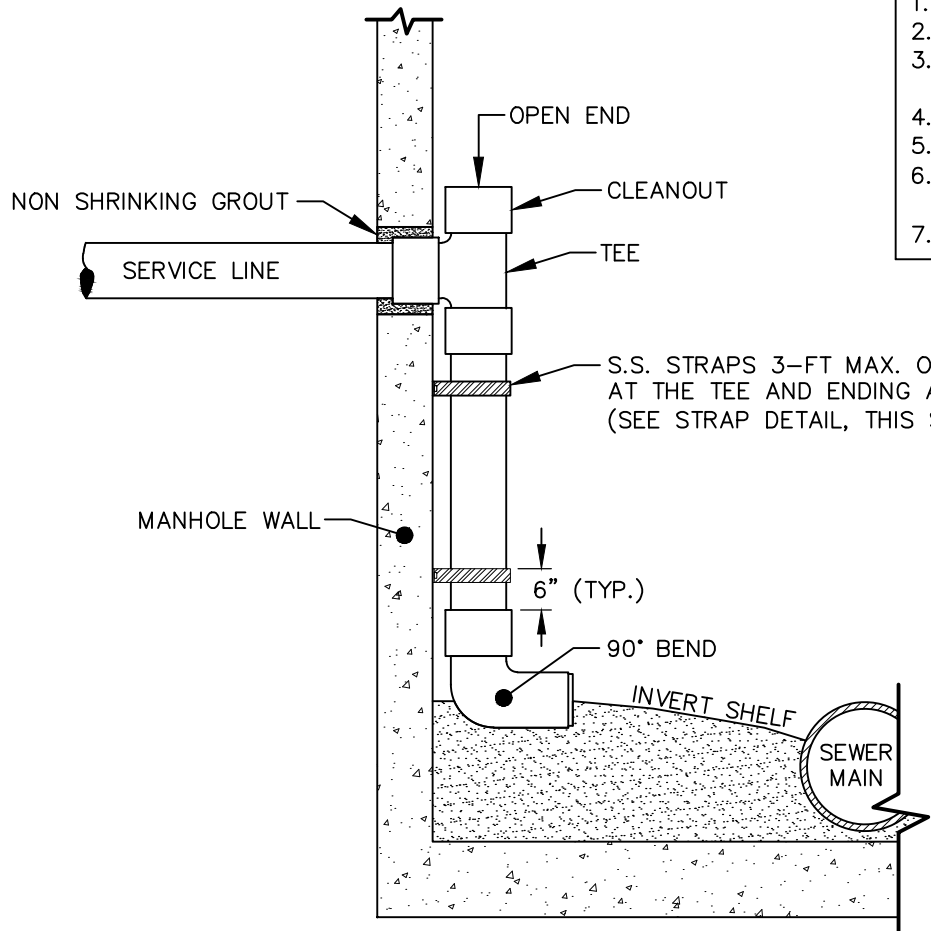

SECTION VIEW

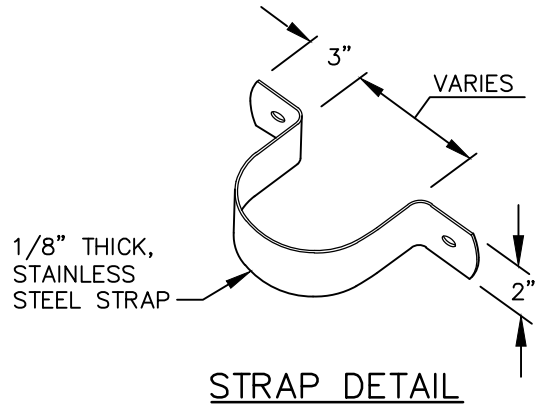

STRAP DETAIL

EFFECTIVE: 01/05/17

STANDARD INSIDE DROP FOR SANITARY SEWER SERVICE

DETAIL No.  
07000.07  
SHEET 1 OF 1