


STANDARD BEDDING
FOR 4' TO 14' DEPTHS

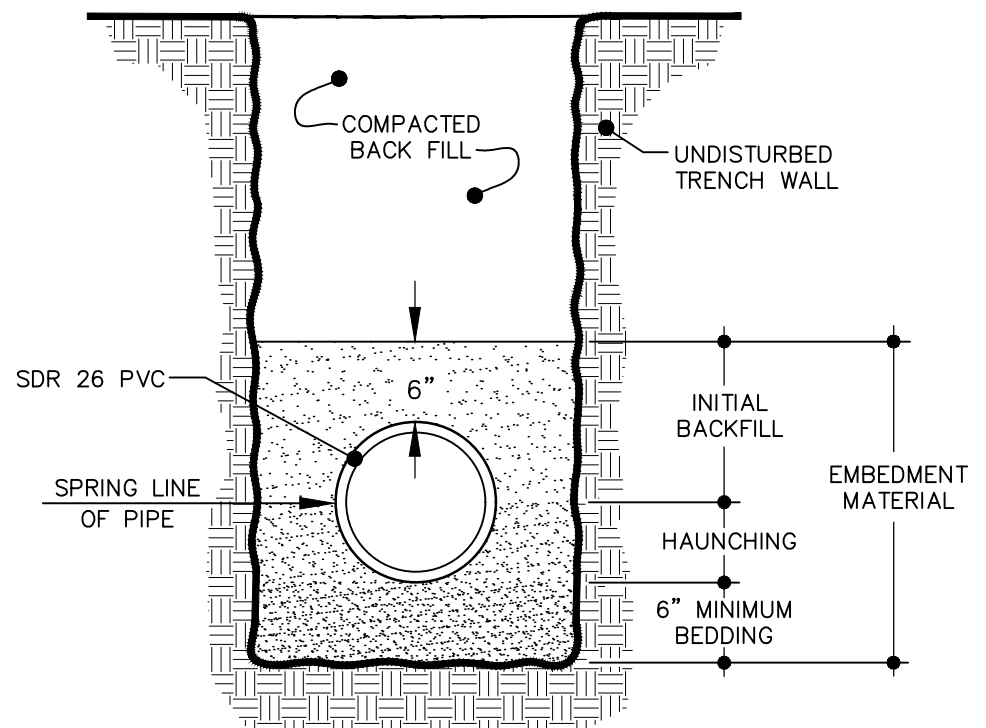

SPECIAL BEDDING
FOR 14'-20' DEPTHS

NOTES:

1. EMBEDMENT MATERIAL MUST BE CLASS I (#67 OR #78M WASHED STONE IS TYPICALLY USED).
2. EMBEDMENT MATERIAL SHALL BE COMPACTED TO A MINIMUM 95% STANDARD PROCTOR DENSITY FOR CLASS I MATERIAL.
3. UNSTABLE TRENCH BOTTOMS SHALL HAVE AN APPROVED FOUNDATION PLAN PRIOR TO PIPELINE INSTALLATION.
4. ALL SANITARY SEWER LINES LESS THAN 4 FEET AND OVER 20 FEET IN DEPTH MUST BE DUCTILE IRON PIPE.



EFFECTIVE: 01/05/17

BEDDING FOR PVC SANITARY SEWER PIPE

DETAIL No.

07000.12

SHEET 1 OF 1