



NOTES:

1. COAT INTERIOR OF MANHOLE WITH APPROVED EPOXY COATING AT MINIMUM 80 mils.
2. ELEVATION OF GRAVITY SEWER INVERT SHALL BE MINIMUM ONE INCH ABOVE ELEVATION OF FORCE MAIN CROWN.
3. PROVIDE SMOOTH UPWARD SLOPING CHANNEL FROM FORCE MAIN TO GRAVITY SEWER.
4. FORCE MAIN SHALL NOT CONNECT WITH EXISTING GRAVITY SEWER MANHOLES.

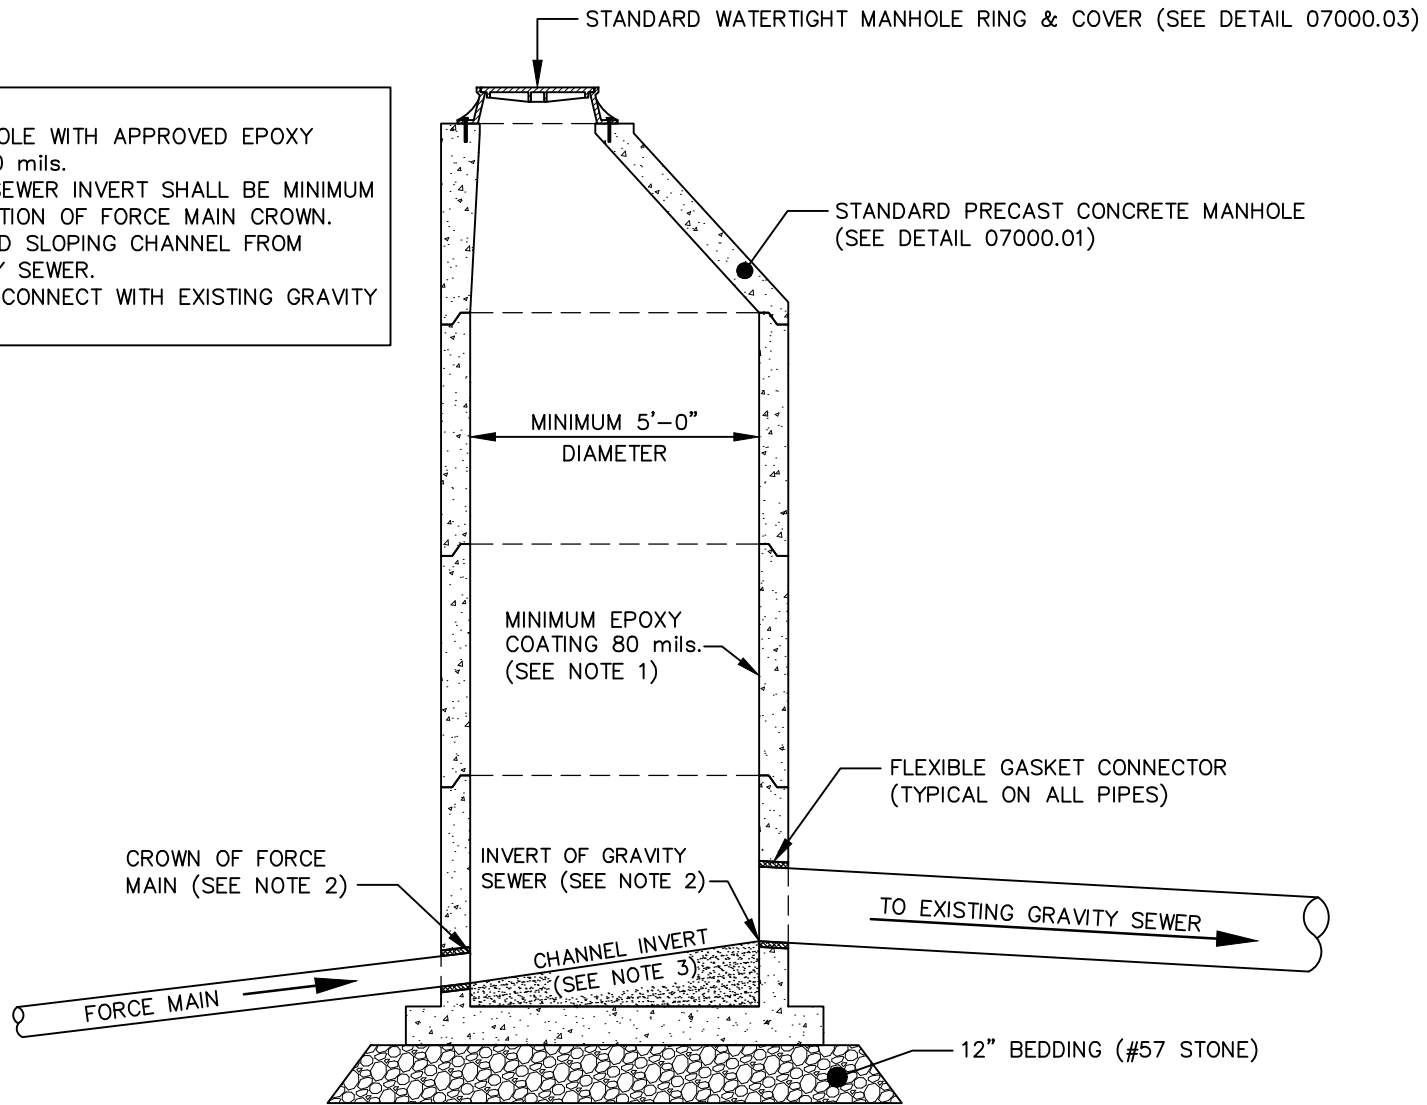

EFFECTIVE: 01/05/17

**FORCE MAIN DISCHARGE MANHOLE, TYPE 1
UPWARD SLOPING FORCE MAIN**

DETAIL No.

07200.01

SHEET 1 OF 2