


**NOTES:**

1. COAT INTERIOR OF MANHOLE WITH APPROVED EPOXY COATING AT MINIMUM 80 mils.
2. ELEVATION OF FORCE MAIN CROWN SHALL BE AT SAME ELEVATION AS THE GRAVITY SEWER CROWN.
3. PROVIDE SMOOTH CHANNEL FROM FORCE MAIN TO GRAVITY SEWER.
4. FORCE MAIN SHALL NOT CONNECT WITH EXISTING GRAVITY SEWER MANHOLES.

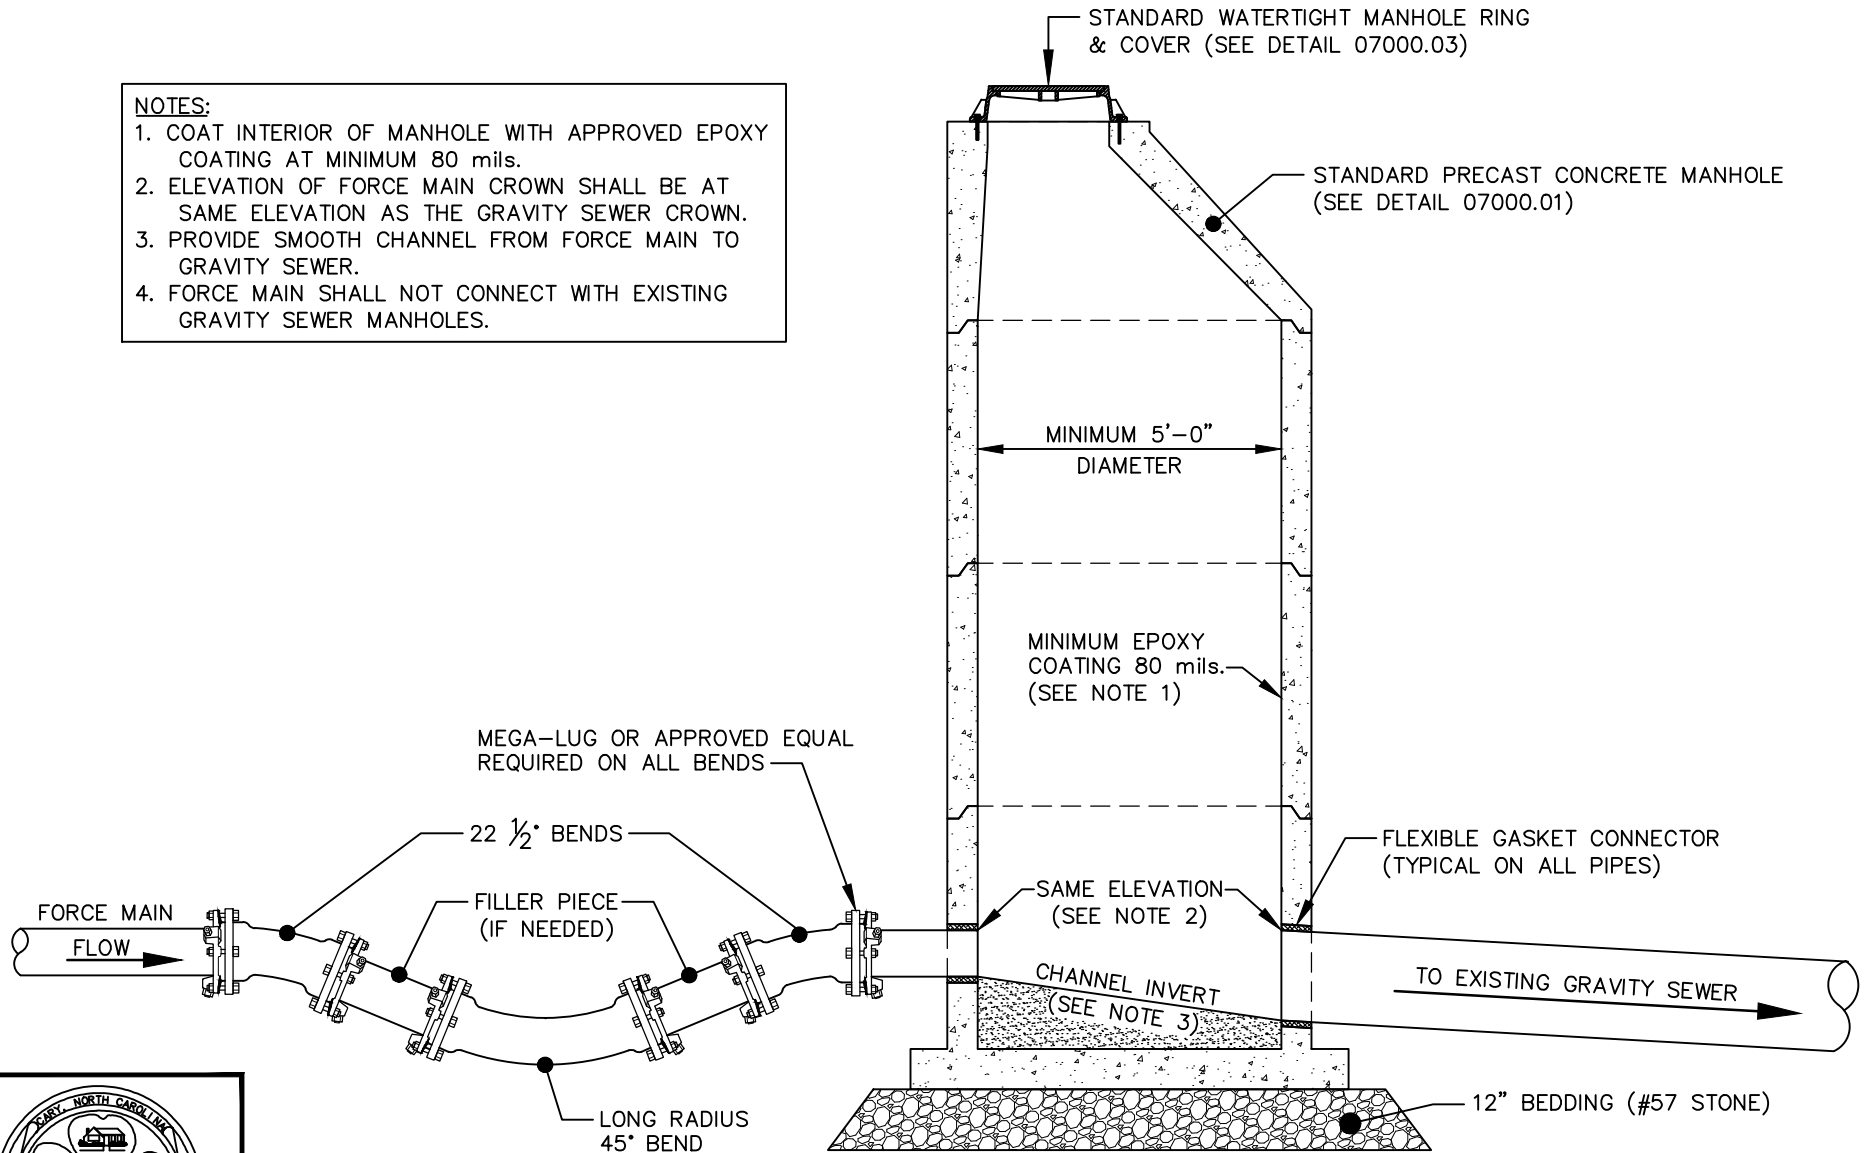

EFFECTIVE: 01/05/17

**FORCE MAIN DISCHARGE MANHOLE, TYPE 2  
FLAT OR DOWNWARD SLOPING FORCE MAIN**

DETAIL No.

07200.01  
SHEET 2 OF 2