


NOTES:

1. PUMP STATION PROPERTY OR EASEMENT SHALL BE 50' x 50' (ft.) MINIMUM.
2. EQUIPMENT LOCATIONS AND DIMENSIONS MAY VARY.
3. SITE WITHIN FENCE SHALL BE 5 INCH THICK REINFORCED CONCRETE SLAB OR 3 INCHES CRUSHED STONE OVER GEOTEXTILE FABRIC (SPECIFIED BY DIRECTOR OF WATER RESOURCES).
4. THE PUMP STATION SITE LAYOUT AND DESIGN SHALL MEET ALL TOWN OF CARY SITE PLANNING AND DESIGN REQUIREMENTS.
5. PIGGING & BYPASS CONNECTION LOCATION WILL VARY.

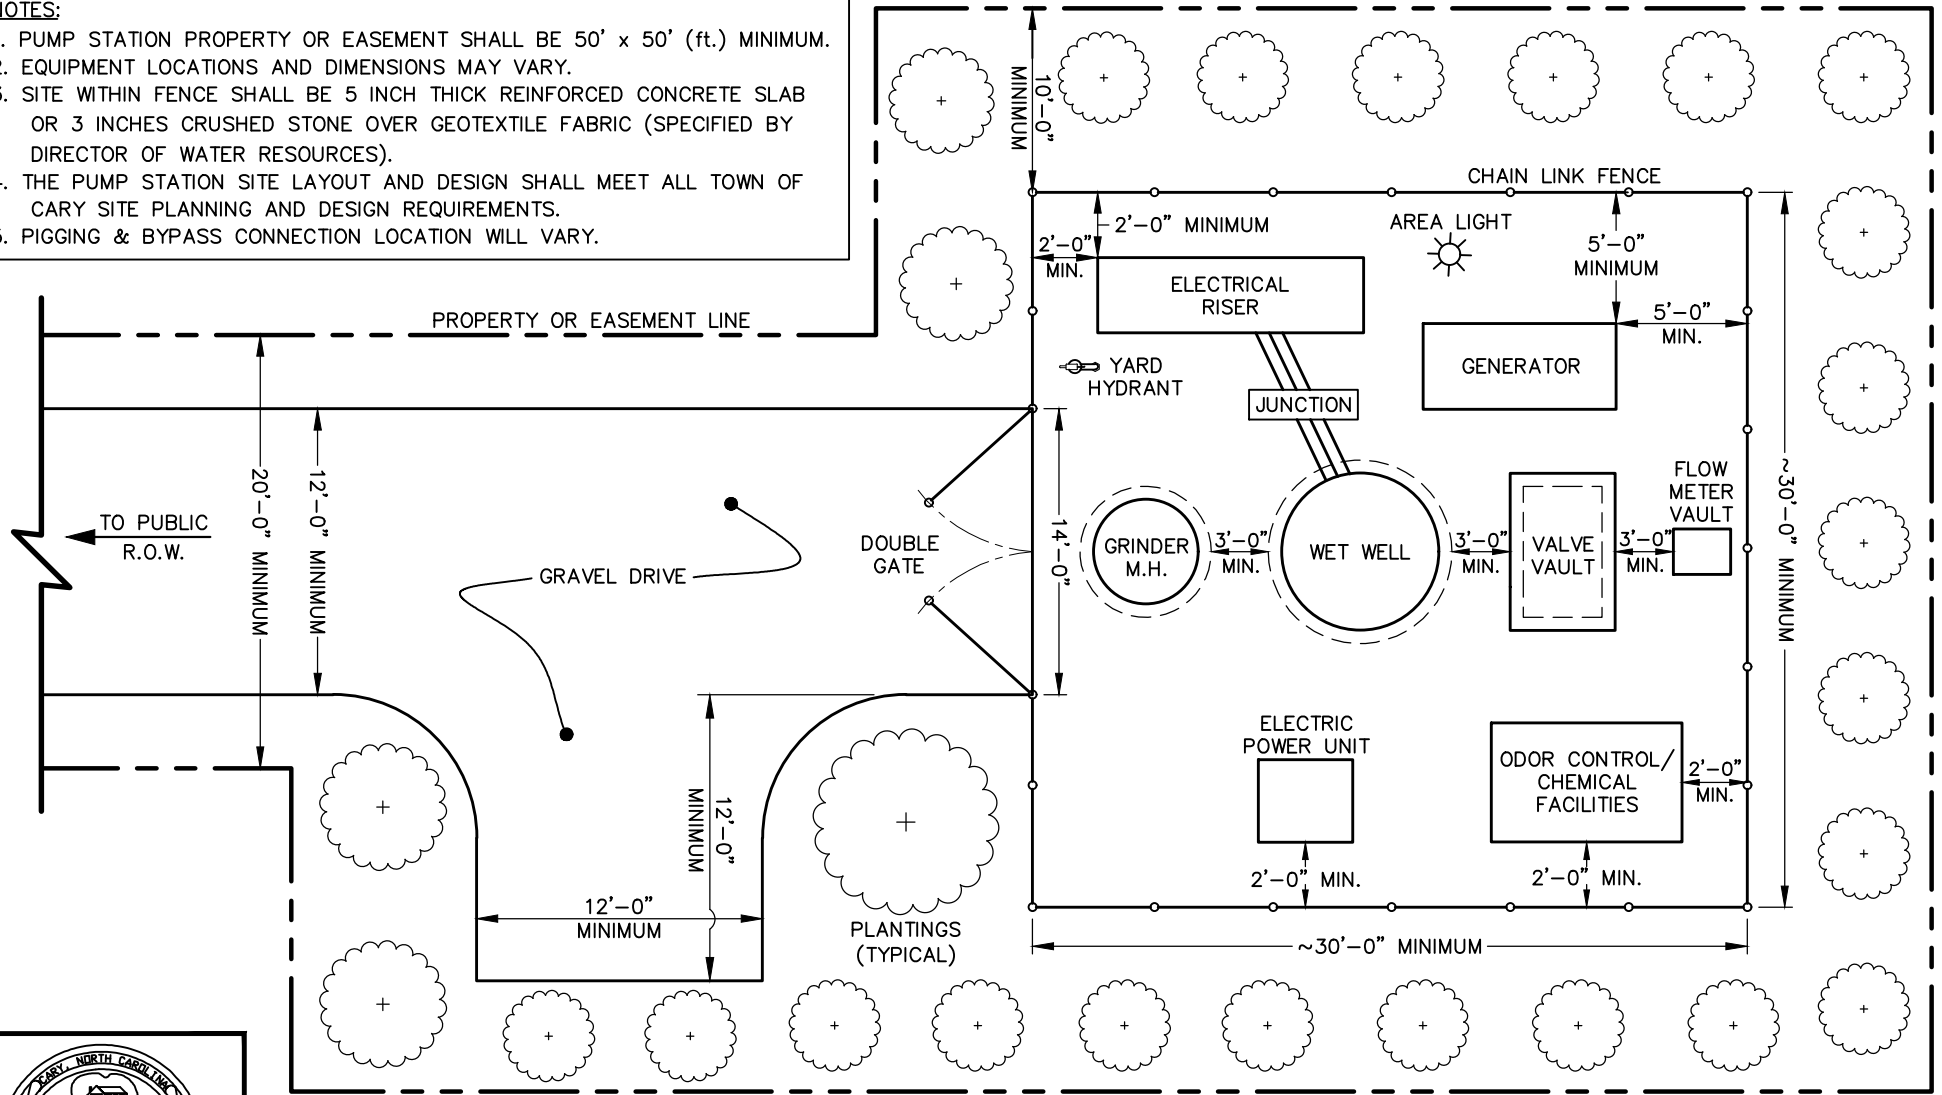

EFFECTIVE: 01/05/17

PUMP STATION SITE LAYOUT

DETAIL No.

07500.01

SHEET 1 OF 1