


PLAN VIEW

SEE SHEET 2 OF 2 FOR SECTION "B-B"

ALUMINUM ACCESS HATCH

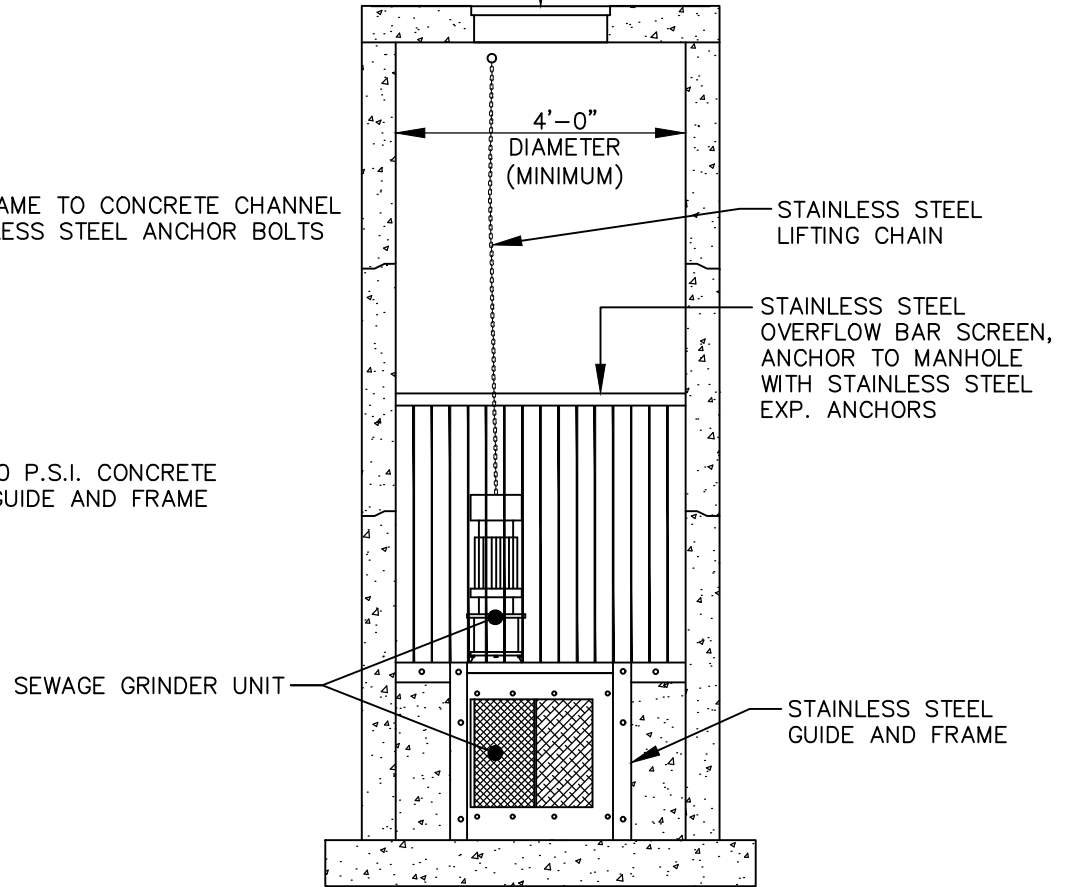

SECTION "A-A"

NOTES:

1. THERE SHALL ONLY BE A SINGLE INFLUENT LINE INTO THE GRINDER MANHOLE.
2. GRINDER MANHOLES SHALL BE EPOXY COATED (80 mils).
3. ALUMINUM ACCESS HATCH SHALL BE SIZED TO ALLOW INSTALLATION AND REMOVAL OF GRINDER UNIT.



SEWAGE GRINDER UNIT (MANHOLE INSTALLATION)

DETAIL No.

07500.03

SHEET 1 OF 2

EFFECTIVE: 01/05/17