


PLAN VIEW

SEE SHEET 2 OF 2 FOR SECTION "B-B"

NOTE:
ACCESS HATCH SHALL BE SIZED TO ALLOW FOR INSTALLATION AND REMOVAL OF GRINDER UNIT.

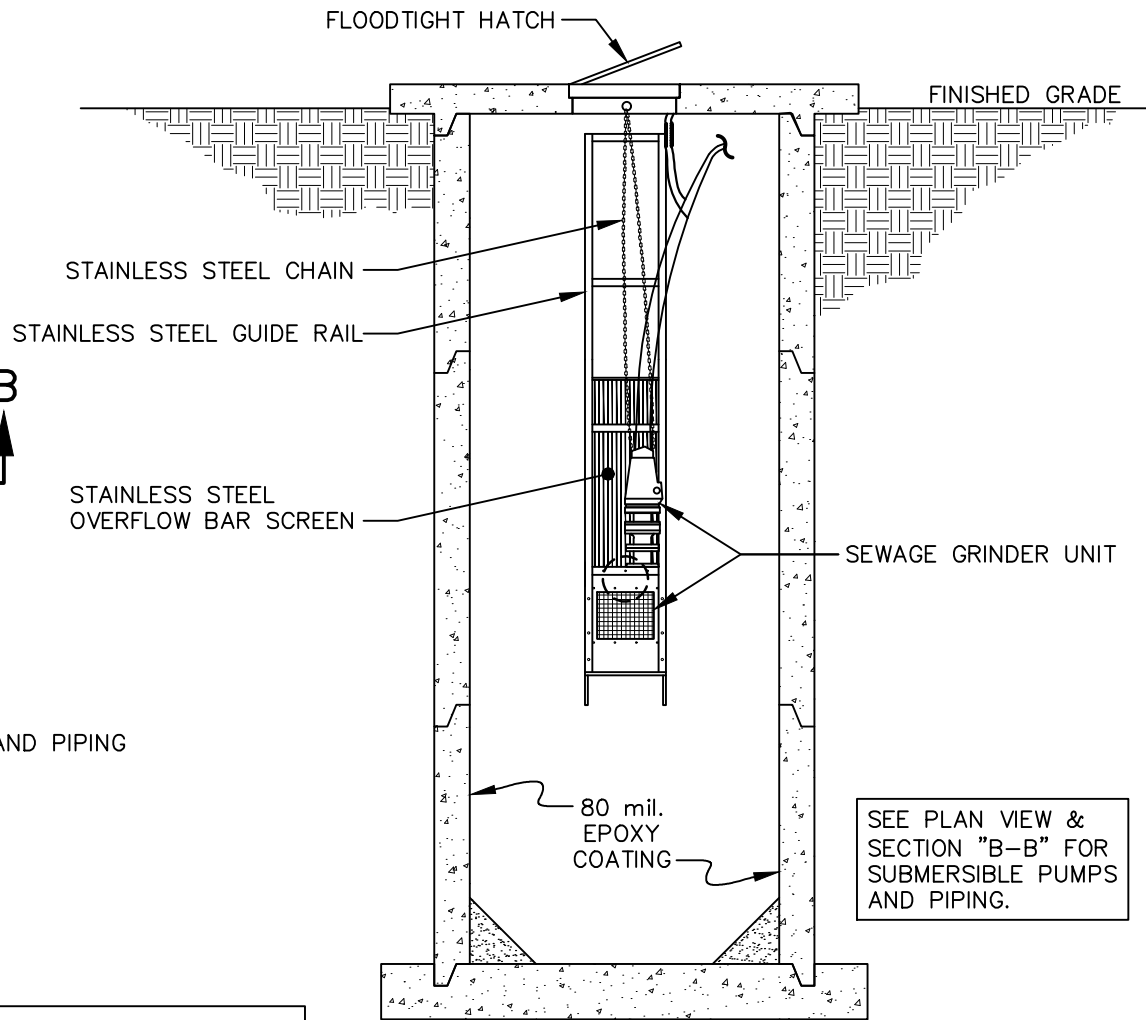

SECTION "A-A"

SEE PLAN VIEW & SECTION "B-B" FOR SUBMERSIBLE PUMPS AND PIPING.



EFFECTIVE: 01/05/17

SEWAGE GRINDER UNIT (WET WELL INSTALLATION)

DETAIL No.

07500.04

SHEET 1 OF 2