

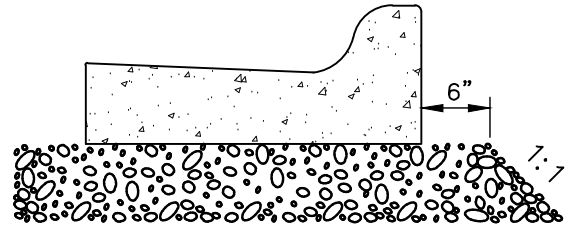


COMBINATION CURB AND GUTTER

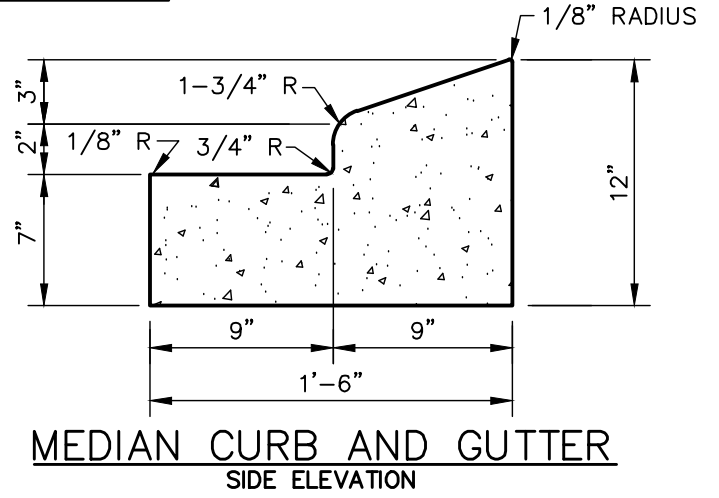

- NOTES:
1. CONCRETE SHALL BE 3,000 P.S.I.
  2. CONTRACTION JOINTS SHALL BE SPACED AT 10' INTERVALS.  
(A 15' SPACING WILL BE ALLOWED WHEN A MACHINE IS USED.)
  3. FINISH ALL CONCRETE WITH CURING COMPOUND.
  4. REFER TO NCDOT DETAIL 846.01 FOR CURB AND GUTTER SUPERELEVATION RATES.

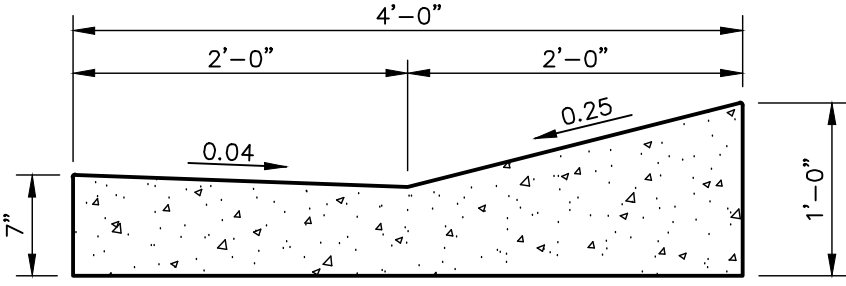

EFFECTIVE: 12/10/09

STANDARD CONCRETE CURB AND GUTTER

DETAIL No.  
03000.02  
SHEET 1 OF 1