


FRONT VIEW

THE EDGES OF THE DRAIN HOLE OR BORE MUST BE ROUNDED AND FINISHED SMOOTH AT THE FACE OF THE CURB.


SECTION A-A

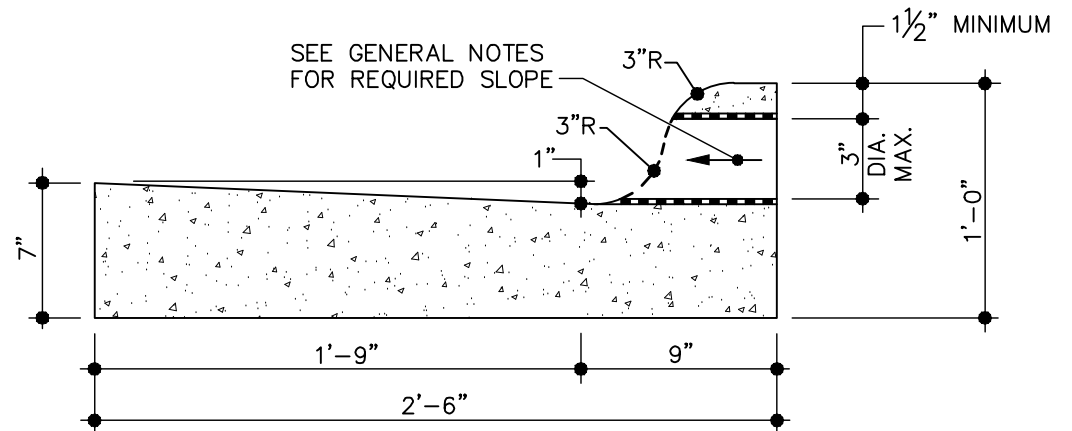

SEE GENERAL NOTES FOR REQUIRED SLOPE

GENERAL NOTES:

- 1) CURB DRAINS SHALL NOT BE CONSTRUCTED WITHIN 18 INCHES OF CONTRACTION OR EXPANSION JOINTS.
- 2) OPENING GRADE MAY VARY BETWEEN A MAXIMUM SLOPE OF 1/2" PER FT. AND A MINIMUM OF 1/4" PER FT.
- 3) MORE THAN ONE HOLE MAY BE INSTALLED PROVIDED THE HOLES ARE LOCATED WITH 18" MINIMUM SPACING.
- 4) IN LIEU OF CUTTING THE CURB TO INSTALL A THREE INCH PIPE, A FOUR INCH CONCRETE BORE MAY BE USED.
  - A) BORE OR REMOVE & REPOUR 5 FT. SECTION OF CURB, NO CUTTING OUT TOP OF CURB.
  - B) MAY NEED PERMIT AND/OR ENCROACHMENT AGREEMENT FROM THE PUBLIC WORKS AND/OR ENGINEERING DEPARTMENT'S.



EFFECTIVE: 12/10/09

STANDARD CURB DRAIN

DETAIL No.

03000.12

SHEET 1 OF 1