



NOTES:

- 1) SAMPLING STATIONS SHALL BE 18"–24" BURY, WITH A 3/4" THREADED NOZZLE WITH 'NO LEAD' BRASS CAP.
- 2) ALL STATIONS SHALL BE ENCLOSED IN A LOCKABLE, NON-REMOVABLE, ALUMINUM-CAST HOUSING.
- 3) A COPPER VENT TUBE WILL ENABLE EACH STATION TO BE PUMPED FREE OF STANDING WATER TO PREVENT FREEZING AND TO MINIMIZE BACTERIA GROWTH.
- 4) PADLOCK PROVIDED BY TOWN OF CARY PUBLIC WORKS DEPARTMENT.
- 5) ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.

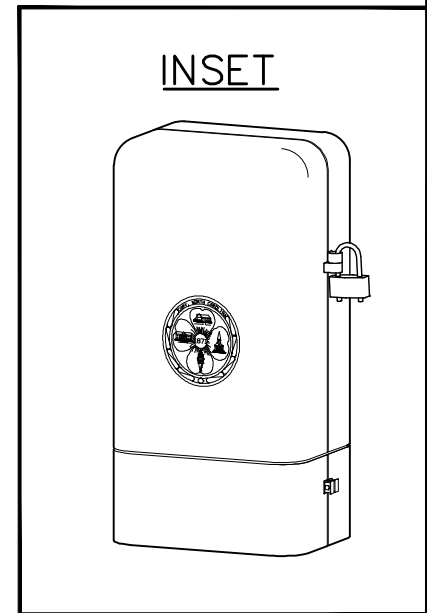

SAMPLING STATION



EFFECTIVE: 07/01/13

DETAIL No.

06000.20

SHEET 1 OF 1