


**NOTES:**

- 1) REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY SHALL COMPLY WITH ASSE 1013 & AWWA C511.
- 2) DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY SHALL COMPLY WITH ASSE 1015 & AWWA C510.
- 3) BACKFLOW PREVENTION ASSEMBLY SHALL MAINTAIN MINIMUM CLEARANCES FROM WALLS AND FLOOR AS SPECIFIED.
- 4) EXTERIOR ACCESS DOOR TO BACKFLOW ASSEMBLY IS REQUIRED.
- 5) PIPE MATERIAL SHALL BE COPPER (TYPE K) OR BRASS (ASTM B43).
- 6) INSTALLATION SHALL BE IN COMPLIANCE WITH ALL APPLICABLE TOWN ORDINANCES AND SPECIFICATIONS IN ADDITION TO THE N.C. PLUMBING CODE.
- 7) PROPERTY OWNER SHALL BE RESPONSIBLE FOR MAINTENANCE AND OPERATION OF BACKFLOW ASSEMBLY AND COMPLIANCE WITH REPORTING AND TESTING REQUIREMENTS.

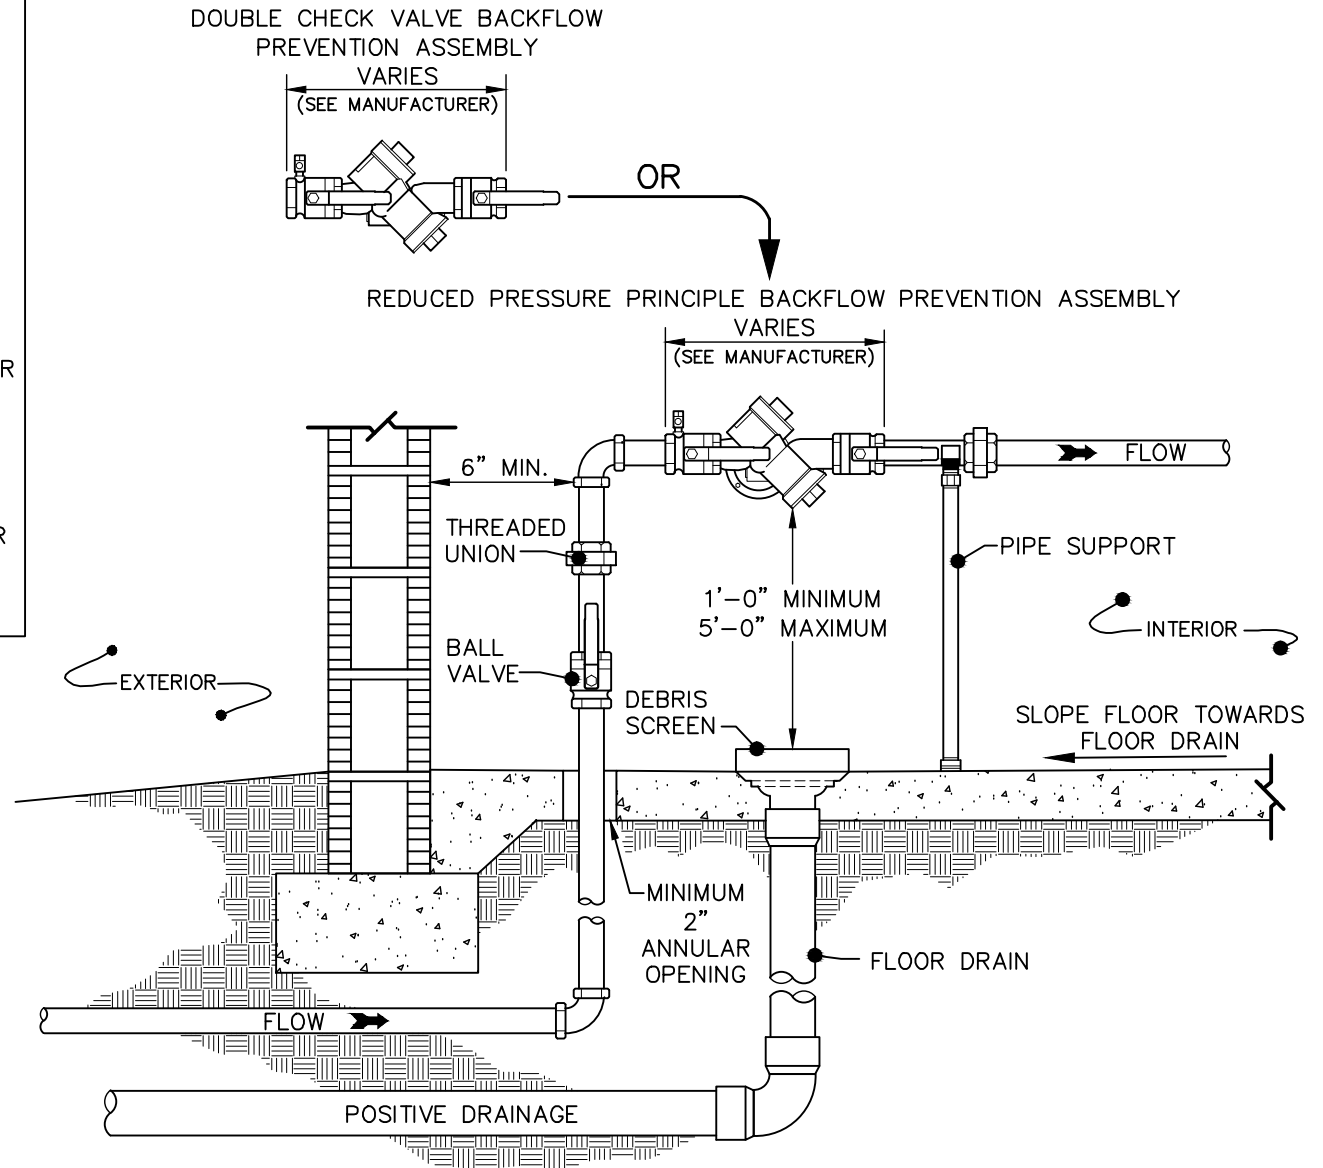

EFFECTIVE: 12/10/09

**STANDARD 1" to 2 1/2" COMMERCIAL INDOOR BACKFLOW ASSEMBLY**

DETAIL No.

06200.04  
SHEET 1 OF 1