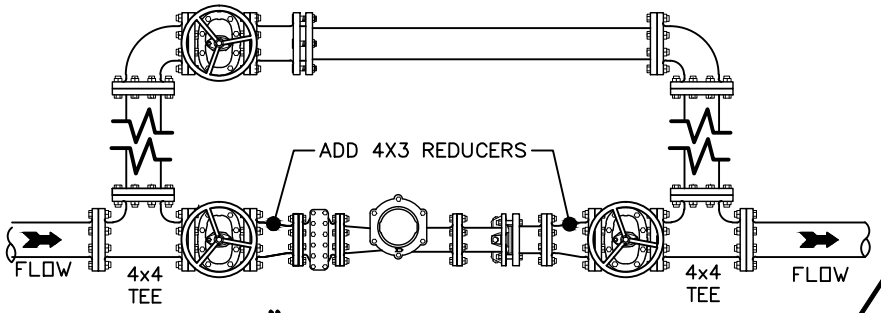

3" METER ASSEMBLY

PLAN VIEW

(SEE SHEET 3 OF 5 FOR SECTION VIEW)

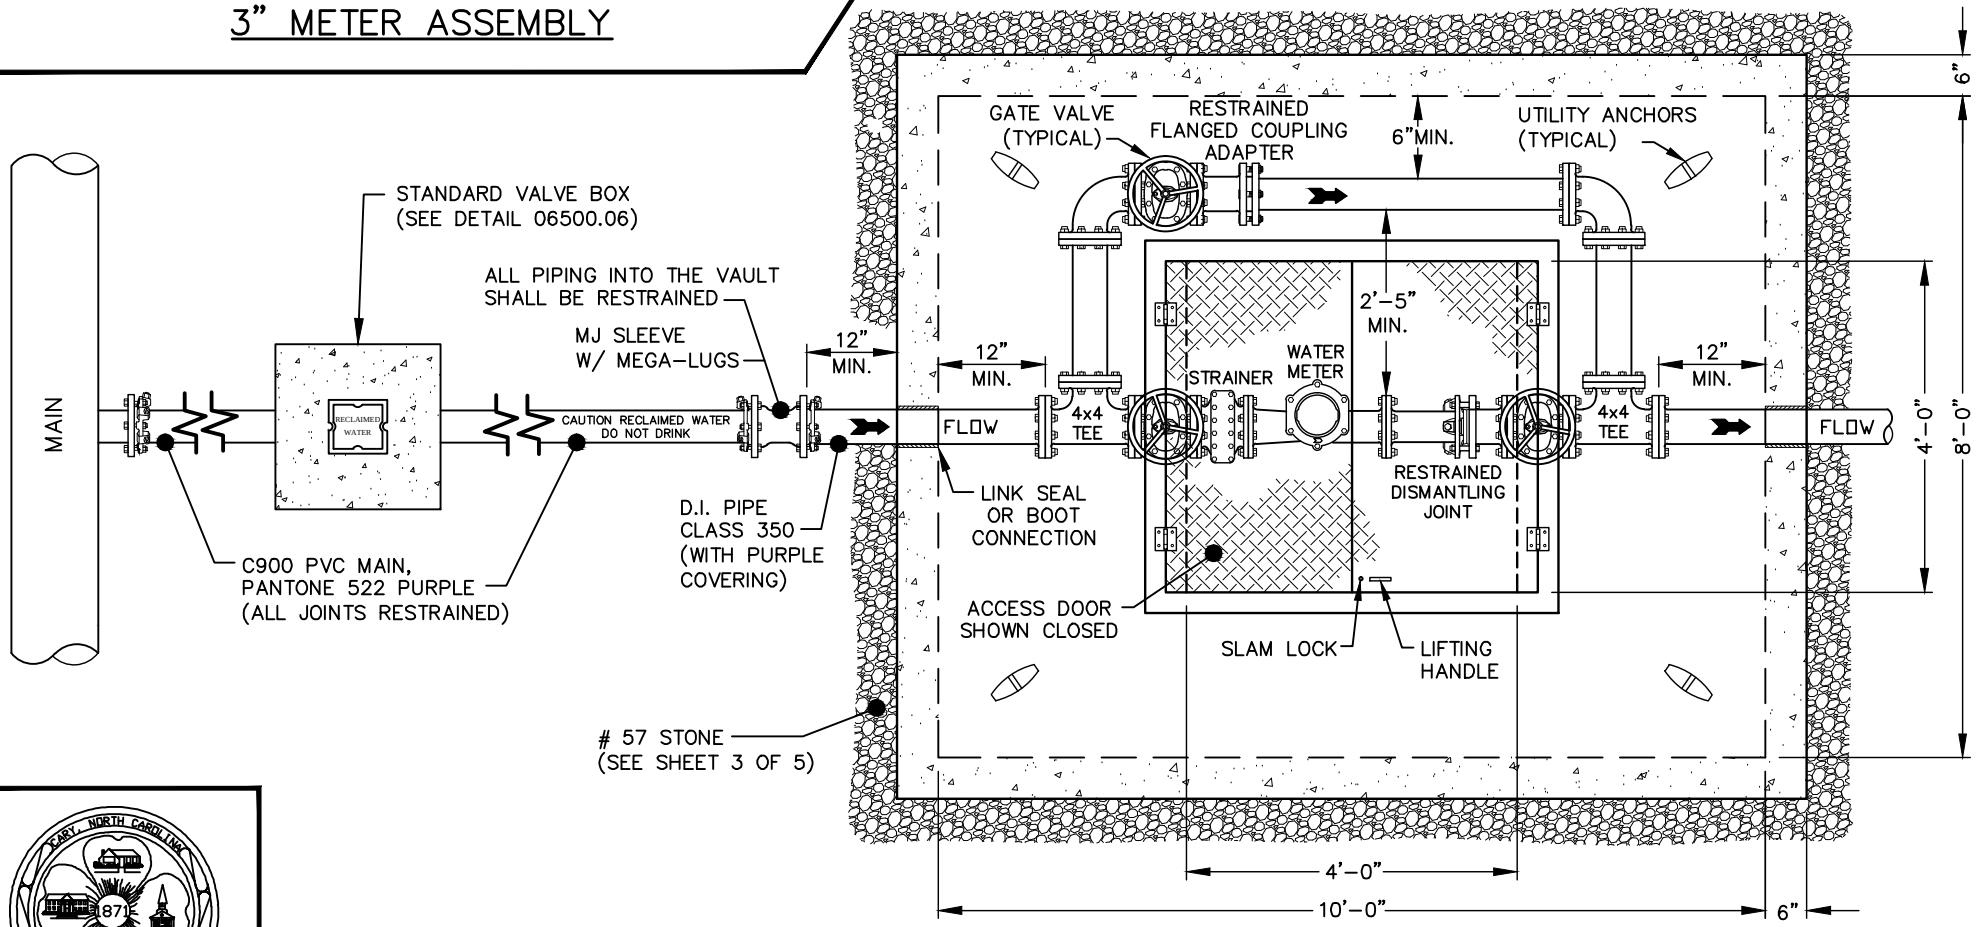

EFFECTIVE: 12/10/09

STANDARD RECLAIMED WATER 3" OR 4" METER INSTALLATION & VAULT

DETAIL No.
06500.02
SHEET 4 OF 5