



**STANDARD BEDDING
FOR 3' TO 14' DEPTHS**

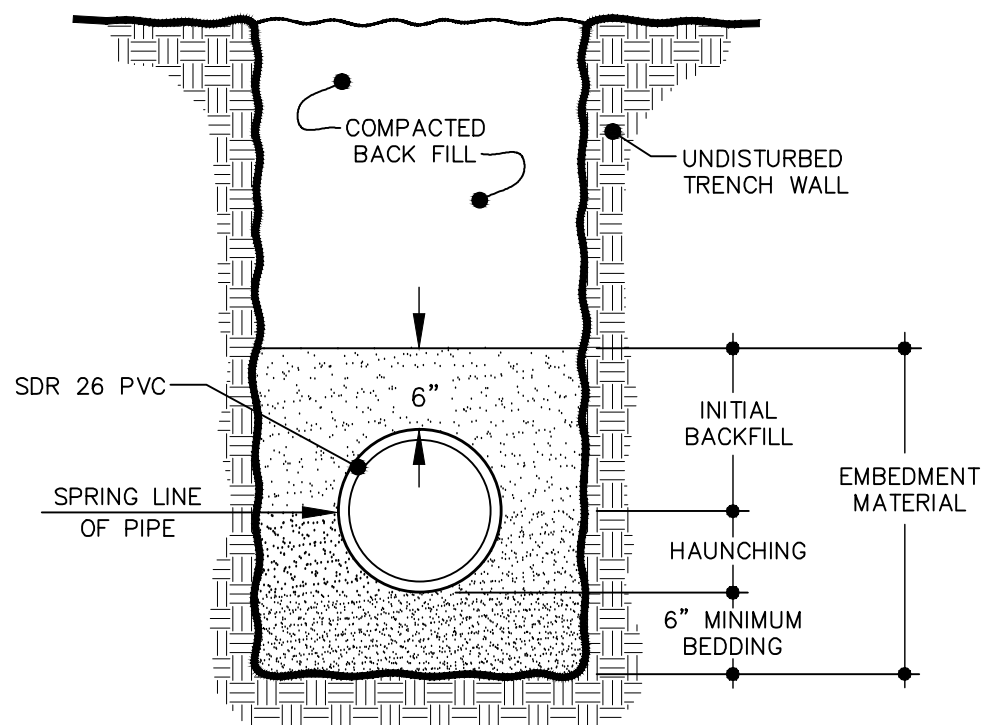

**SPECIAL BEDDING
FOR 14'-30' DEPTHS**

NOTES:

1. EMBEDMENT MATERIAL MUST BE CLASS I (#67 OR #78M WASHED STONE IS TYPICALLY USED).
2. EMBEDMENT MATERIAL SHALL BE COMPACTED TO A MINIMUM 95% STANDARD PROCTOR DENSITY FOR CLASS I MATERIAL.
3. STANDARD BEDDING SHALL BE UTILIZED FOR ALL CASES WHERE TRENCH BOTTOMS ARE UNSTABLE DUE TO SOIL TYPE OR MOISTURE CONDITIONS.
4. ALL SANITARY SEWER LINES LESS THAN 3 FEET AND OVER 30 FEET IN DEPTH MUST BE DUCTILE IRON PIPE.



EFFECTIVE: 12/10/09

BEDDING FOR PVC SANITARY SEWER PIPE

DETAIL No.

07000.13
SHEET 1 OF 1